
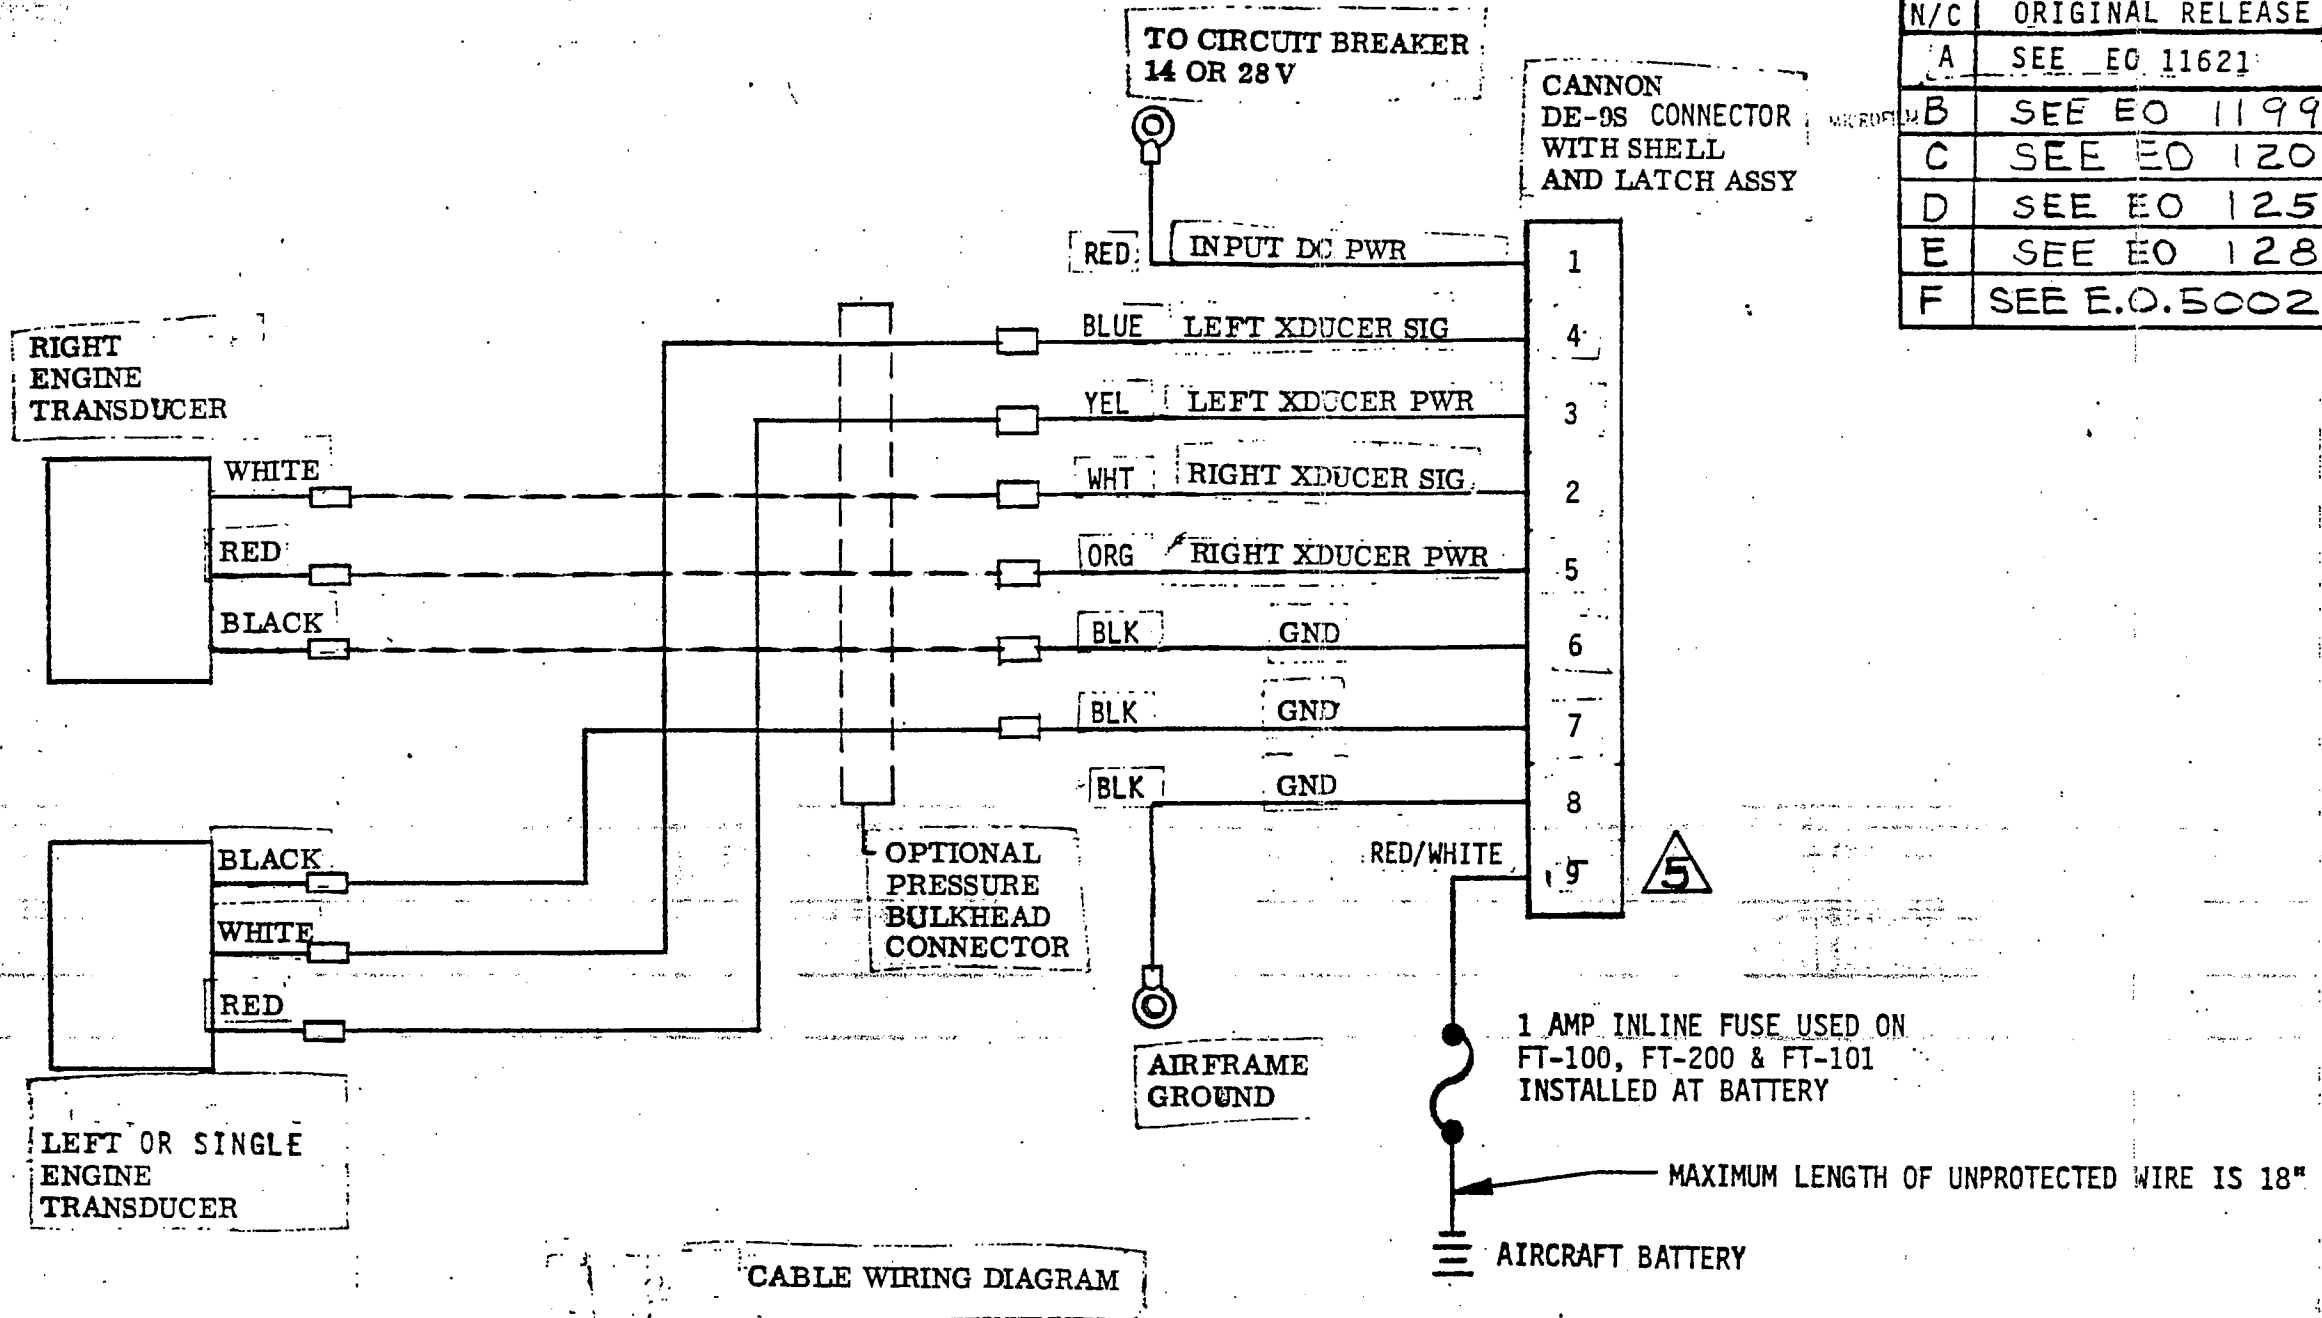


REVISIONS			
LTR	DESCRIPTION	DATE	APPROVED
N/C	ORIGINAL RELEASE	1-27-8	UKC
A	SEE EG 11621	3/15/8	OKC
B	SEE EO 11992	6-27-8	OKC
C	SEE EO 12082	7-27-8	OKC
D	SEE EO 12556	11-3-78	OKC
E	SEE EO 12884	2-7-79	OKC
F	SEE E.O. 50021	12/23/80	OKC



CABLE WIRING DIAGRAM

5. CONNECTOR PIN 9 IS FUNCTIONAL FOR FT-100/200 & FT-101 ONLY.
  4. SHIELDING 3 CONDUCTOR OPTIONAL (MIL - W - 5086)
  3. USE AWG 20 5086A WIRE OR EQUIV.
  2. BARREL OR SCISSOR CONNECTOR  No. 31777 AMP or Equiv.
  1. ALL WIRING MUST COMPLY WITH A.C. 43.13-1, CH. 11.
- NOTE: UNLESS OTHERWISE SPECIFIED SECTS 2, 3, 7 REQUIREMENTS

This document contains proprietary information and design owned by Symbolic Displays, Inc., except as specific rights are granted to the United States Government, other Government agencies or other person or firm as defined by contract or other document executed by Symbolic Displays, Inc. Neither this document nor its contents may be disclosed or reproduced in whole or in part without the written permission of Symbolic Displays, Inc.

ITEM NO.	DWG SIZE	PART NO.	DESCRIPTION
QTY REQD		LIST OF MATERIAL	
UNLESS OTHERWISE SPECIFIED			
DIMENSIONS ARE IN INCHES AND INCLUDE CHEMICAL, PLATED, OR PAINTED FINISHES.			
TOLERANCES ON			
FRAC	2 PLACE	3 PLACE	ANGLES
+ -	+ -	+ -	+ -
SURFACE FINISH PER MIL-STD-10		BREAK ALL SHARP EDGES	
DRAWN <i>KAMON</i>		DATE 1-23-78	TITLE CABLE WIRING DIAGRAM FOR
CHECKED <i>L. Coakley</i>		DATE 1-27-78	CFS-1000/2000, CFS-1001/2001, FT-100/200
DESIGN ENG. <i>at least 10/10</i>		DATE 1-27-78	SIZE CODE GENT NO. DRAWING NO. REV
APPROVED		DATE	B 19565 204200 F
N/A		USED ON	SCALE: NONE SHEET / OF /